

FIRE SAFETY PLAN FOR:

Braun Building
Lakehead University
955 Oliver Road
Thunder Bay, Ontario
P7B 5E1

Reviewed without change - June 2025

Reviewed by:

Brenda Huska
Lakehead University
Health & Safety

Reviewed by:

Kevin Anderson
Director of Fire Prevention
Thunder Bay Fire Rescue

Table of Contents

Chapter 1: Introduction	5
Chapter 2: Audit of Human Resources.....	6
Chapter 3: Audit of Building Resources	7
3.1 General Description	7
i. 7	
ii. 7	
3.2 Fire Alarm System	7
i. 8	
ii. 8	
3.3 Special Extinguishing Systems	8
i. Ancillary Functions	9
3.4 Standpipe System	9
3.5 Fire Hydrants	9
3.6 Fire Extinguishers	9
3.7 Elevators	10
3.9 Emergency Power	10
3.10 Main Hydro Shut-Off	10
3.11 Gas Shut-Off Valve	11
3.12 Water Shut-Off Valve	11
3.13 Hazards	11
Chapter 4: Building Schematics 4.1 Fire Access Routes	12
	12
4.2 Site Plan	13
4.3 Main Floor Plan	14
4.4 Second Floor & Basement Floor Plan	15
Chapter 5: Responsibilities & Emergency Procedures.....	16
5.1 Building Owner and Management (President, VP Finance & Administration)	16
5.2 Employers, Managers and Supervisors	17
5.3 Physical Plant (Mechanical & Electrical Staff)	18
i. 18	

5.4 Security	19
i. 19	
5.5 Fire Wardens	20
i. 21	
5.6 Evacuation Meeting Locations	22
5.7 Teachers and Instructors	22
i. 22	
5.8 Persons Requiring Assistance to Evacuate	23
i. 23	
5.9 All Occupants	24
i. 24	
5.10 Extra Precautions While Exiting	25
5.11 Special Evacuation Procedures	26
i. 26	
ii. 26	
5.12 Laboratories	26
i. 27	
ii. 28	
5.13 Storage and Collection Room (Anthropology)	29
5.14 Technology Services Centre (TSC)	29
5.15 Hazardous Materials Emergencies	30
i. Minor Chemical Spills	30
ii. Major Chemical Spills	30
5.16 Fire Service Elevator-Operation Instructions	31
i. Phase 1 Operation.....	31
ii. Phase 2 Operation.....	31
iii. Return to Phase 1	31
Chapter 6: Fire Extinguishment, Control or Confinement.....	31
6.1 Suggested Operation of Portable Fire Extinguishers	32
6.2 Classification of Fires	32
6.3 Classification of Fire Extinguishers	33

Chapter 7: Fire Hazards and Fire Prevention	33
7.1 Housekeeping	34
7.2 Fire Doors	34
7.3 General Hazards	34
7.4 Electrical Hazards	34
7.5 Extension Cords	35
7.6 Space Heaters and Appliances	35
7.7 Storage Areas	35
7.8 Flammable and Combustible Liquids	36
7.9 Compressed Gas	36
7.10 Hot Works	37
7.11 Special Events	37
i. Portable Cooking Devices.....	37
Chapter 8: Fire Protection Measures	37
8.1 Fire Alarms & Pull Stations	37
8.2 Fire Extinguishers	37
8.3 Emergency Exits	38
8.4 Emergency Lighting	38
8.5 Fire Routes	38
Chapter 9: Alternative Measures for Fire Safety	38
9.1 Fire Alarm Systems	38
9.2 Water System Shutdown	39
9.3 Emergency Power Shutdown	39
9.4 Fire Watch	39
9.5 Exits	39
9.6 Fire Extinguishers	40
Chapter 10: Fire Drills	40
Chapter 11: Maintenance Schedule as Required by the Ontario Fire Code	40
11.1 Daily Tasks	41
11.2 Monthly Tasks	41
11.3 Semi-annual Tasks	42
11.4 Annual Tasks	42

11.5 Tasks Every Five (5) Years	43
11.6 Tasks Every Six (6) Years	43
11.7 Tasks Every Twelve (12) Years	43
11.8 Tasks, As Required	43
Appendix A: Fire Drill Report	45
Appendix B: SDS - FM 200	46

Chapter 1: Introduction

As required by the Ontario Fire Code, Section 2.8, (Ontario Regulation 213/07 of the Ontario Fire Protection and Prevention Act, as amended), this Fire Safety Plan has been prepared by Lakehead University for the Braun Building, 955 Oliver Road, Thunder Bay, Ontario.

The purpose of the plan is to provide safety information for all occupants in the event of a fire, to ensure the effective use of life saving features in the building, and to prevent fires from being initiated. This fire safety plan has been designed to suit the resources of the Braun Building. This plan must be approved by Thunder Bay Fire Rescue; however, Lakehead University is responsible for ensuring that the information provided in this fire plan is accurate and complete.

Information found within this Fire Plan includes: contact information, an audit of building resources, maintenance of building resources (as required by the Ontario Fire Code), building schematics, and an outline of responsibilities, emergency procedures, control and extinguishment of a fire, fire protection measure and fire hazards and prevention.

The Fire Protection and Prevention Act, Part VII, Section 28 states that any person who contravenes any provision of the fire code is guilty of an offence. If convicted a company or corporation is liable to a fine of not more than \$100,000. Any individual, director or officer of a corporation is liable for a fine of not more than \$50,000 or imprisonment for a term of not more than one year, or both.

The Fire Safety Plan shall be reviewed as often as necessary, but at intervals not greater than twelve (12) months, to ensure that it takes account of changes in use and other characteristics of the building. The Chief Fire Official is to be notified regarding any subsequent changes in the contents of the approved Fire Safety Plan.

This official document is to be kept readily available at all times for use by staff and fire officials in the event of an emergency

The approved location of the Fire Safety Plan for the Braun Building is the Security Office, UC 1016. In addition, copies will be kept in the Health & Safety Office and in a Fire Safety Plan box located by the Fire Alarm Annunciator.

Electronic copies of the Fire Plan will be posted on the Health & Safety website.

Chapter 2: Audit of Human Resources

Building Owner	Lakehead University 955 Oliver Road Thunder Bay, ON P7B 5E1 Phone: 807-343-8110
President	Dr. Gillian Siddall 955 Oliver Road Thunder Bay, ON P7B 5E1 Phone: 807-343-8010 ext.8200
Vice President, Finance & Administration	Kathy Pozihun Phone: 807-343-8010 ext.8383
Director, Physical Plant	Hugh Briggs Phone: 807-343-8010 ext.8790
Health & Safety, Office of Human Resources	Brenda Huska Phone: 807-343-8010 ext.8806 Tiffany Moore Phone: 807-343-8010 ext.8671
Security Staff	On site 24/7, minimum 3 people Phone: 807-343-8911 (Emergencies) Phone: 807-343-8010 ext.8569 (Non-emergency)
Maintenance Staff	Physical Plant, available from 8am to 4pm (After hours contact Security) Phone: 807-343-8010 ext.8273
Cleaners	Physical Plant, Arno Kalbus, Facilities Manager Phone: 807-343-8010 ext.8962 Physical Plant, Services Supervisor, Phone: 807-343-8010 ext.8968

Fire Alarm Monitoring Company	Tbay Tel Phone number and passwords are held by Security Services (807-343-8010 ext.8569).
-------------------------------	---

Chapter 3: Audit of Building Resources

3.1 General Description

The *Braun Building* located at 955 Oliver Road is a non-combustible two(2)-storey building with one (1) basement level constructed from 1956-1966, and renovations completed in 2010.

The operating hours of the building are 6am to 10pm, Monday to Friday.

i. Occupancy and Use

Basement-Mechanical Room, Storage, Offices, Laboratory (Anthropology), Collections (Anthropology), Forestry Lecture Space.

Main Floor- Mechanical Rooms, Boiler Room, Electrical Room, Janitors Closet, Storage, Washrooms, Offices, Conference Room, Lecture Hall, Computer Lab, Music Studio, Prep Rooms, Laboratories (Forest Genetics, Forestry Instrumentation, Geographic Information Systems, Psychology, Forest Pathogens), Woodworking Shop, Technology Service Centre.

Second Floor-Offices, Lecture Hall, Laboratory (Anthropology), Storage, Janitors Closet, Smudging Room.

ii. Fire Department Access

Firefighters will access the property via Oliver Road, Agora Circle entrance. Security Services will call in detailed instructions to the city's Emergency Service Dispatch and provide specific information regarding the alarm, including the building entrance to use and any details concerning the fire (ie. Which zone is affected, any laboratories, chemical storage, woodworking shop, etc.).

Security Officers on patrol are responsible for removing the Access bollards between the Medical School and ATAC.

3.2 Fire Alarm System

This building is provided with an Edwards EST3 single stage system with dual communication paths and meets ULC monitoring standards.

Main Control Panel location: BB 1058

Annunciator Panel location: Braun Building main entrance (X1015). A parallel unit is located at the School of Nursing main entrance (X1010) and another in the security office, UC 1016.

i. Sequence of Operation

Upon activation of a fire alarm initiating device in any portion of the building, a general fire alarm will sound throughout the Braun Building.

ii. Ancillary Functions

The fire alarm system is activated by:

- Manual pull stations
- Smoke detectors
- Duct smoke detectors
- Heat detectors
- Standpipe Flow Switch
- Special Extinguishing System: Two (2)FM-200 Systems

Upon activation of the fire alarm system:

- A fire alarm signal will be transmitted to the Security Office and confirmed at their annunciator panel. A fire alarm signal will also be transmitted to an independent off-site monitoring station.
- The fire alarm annunciator and control panel will display information regarding which zone or detector is affected.
- The Air Handling Units, equipped with duct smoke detectors, will shut down.
- Door hold-opens will release.

Fire dampers are present in the newer portion of the building, located in the duct work. Dampers operate via thermal melts and are not tied to the fire alarm system.

3.3 Special Extinguishing Systems

BB 1047/BB 1049A and BB 1033/BB 1044 are each protected by FM-200 clean agent fire extinguishing systems.

The control panel for the BB 1047/BB 1049A FM-200 suppression system is located in room 1049 of the Braun Building. There are manual pull stations by all exit doors and the Kidde gas is located in the crawl space beneath BB 1047.

The control panel for the BB 1033/BB 1044 FM-200 suppression system is located in room 1033 of the Braun Building. Both BB 1033 and BB 1044 are equipped with Kidde gas and manual pull stations near the exit doors.

Both FM-200 Suppression Systems are supervised by the Braun Building fire alarm system and will be displayed on the Braun Building annunciators (Braun Building main entrance (X1015), the School of Nursing main entrances (Z1010) and in the Security Office (UC 1016). For more information refer to the SDS for FM-200 gas in Appendix B.

i. Ancillary Functions

The FM-200 Suppression System is activated by:

- Manual Pull stations (5 second delay prior to activation).
- Any two (2) Smoke detectors (30 second delay prior to activation).

Upon activation of the FM-200 Suppression System:

- After a brief delay, as described above, the FM-200 Suppression System will activate and Kidde gas will be released.
- The fire alarm for the Braun Building will be activated alerting occupants to evacuate immediately.
- The alarm will be transmitted to Security (UC 1016) and confirmed at their annunciator panel. A fire alarm signal will also be transmitted to an independent off-site monitoring station.
- The fire alarm annunciator in Security will display information regarding which zone is affected and which fire safety device tripped the alarm (manual pull station, or heat detector).
- Air handling unit fans will shut-down.
- Door hold-opens will release.

3.4 Standpipe System

The Braun Building is equipped with a standpipe and hose system located throughout the building.

The control valves are located in BB 1058, as shown on the floor plan. The system is monitored by the Fire Alarm Control Panel via flow and tamper switches.

Fire hose cabinets are located throughout the building, as indicated on the floor plans. All fire hose cabinets house portable fire extinguishers.

Fire Department access for the standpipe system is located on East and West face of the building, as shown on the site plan.

3.5 Fire Hydrants

Private hydrants are located as shown on the site plan. The private hydrants are connected to the municipal water supply.

3.6 Fire Extinguishers

Fire extinguishers are located throughout the building. See floor plans for locations.

3.7 Elevators

One fire service elevator serves the first and second floor (BB DWING Lift D). Refer to floor plans for location. Section 5.16 contains additional details.

- Upon a general alarm the elevator will capture to the main floor.
- If the smoke detector on the main floor in front of the elevator goes into alarm the elevator will retrieve to the alternate home (Second Floor).
- After recall of the fire service elevators phase two (2) can be activated by Firefighters using the fire service key switch.

3.9 Emergency Power

Emergency power is provided by the emergency generator in the powerhouse building (1 megawatt Kohler generator). This emergency generator runs off diesel fuel and will power the main campus for a maximum of 4 days.

Emergency power supplied to the Braun Building will run the Emergency Lighting and Exit Lights.

The fire alarm system is equipped with battery backup. In the event of a power failure, the batteries provide sufficient power to allow the fire alarm to operate in “supervision” mode for 24 hours and the alarm to sound for at least 60 minutes.

In addition to the main emergency power feed, the TSC Server Rooms BB 1047 and BB 1049A are equipped with a dedicated emergency power supply from the Powerhouse. In the event the Braun Building loses power, this emergency supply will continue to power the Server room equipment, the cooling system, emergency lighting and the FM-200 Fire Suppression system.

3.10 Main Hydro Shut-Off

It is important to note that the Braun Building is supplied by multiple hydro sources. Read the following carefully.

The first main hydro disconnect switch is located outdoors on the South face of the building, as shown on the site plan. (A secondary switch can be found in the electrical room, BB 1058, as shown on the floor plan). These disconnect switches will shut off electrical service to a portion of the Braun Building.

The second main hydro disconnect switch is located outdoors on the Northwest face of the Braun Building. This disconnect switch will shut off electrical service to the remaining portion of the Braun Building as well as the School of Nursing.

The final hydro disconnect, for the TSC Server Room emergency power supply, is located on the first floor of the Powerhouse.

3.11 Gas Shut-Off Valve

The main gas shut off valves are located in the basement of the Centennial Building CB X0022 and in the Powerhouse. Refer to those Fire Plans for more detail.

The gas shut off valve in the Powerhouse controls the natural gas supply to the Centennial Building, Greenhouse, University Centre (Cafeteria), Student Centre, CNFER (Forest biology) and the Braun Building.

Some laboratories and the Boiler room (BB 1058) have natural gas supplied, equipped with accompanying gas shut off valves.

3.12 Water Shut-Off Valve

The main water shut-off valve for the Braun Building is located in BB 1058. Upon request Maintenance may also access outdoor curb stops to shut off water supply to the building.

3.13 Hazards


The following classes of hazardous materials are located in the Braun Building:

- Compressed Gases
- Flammable and Combustible Liquids
- Oxidizing Materials
- Poisonous and Infectious Materials
- Corrosive Materials


Upon arrival at the scene, Lakehead University Security Staff can provide the Fire Department personnel with the exact locations of hazardous materials in the building.

Hardcopies of the Material Safety Data Sheets are accessible in each room that contains hazardous materials.

Chapter 4: Building Schematics 4.1 Fire Access Routes

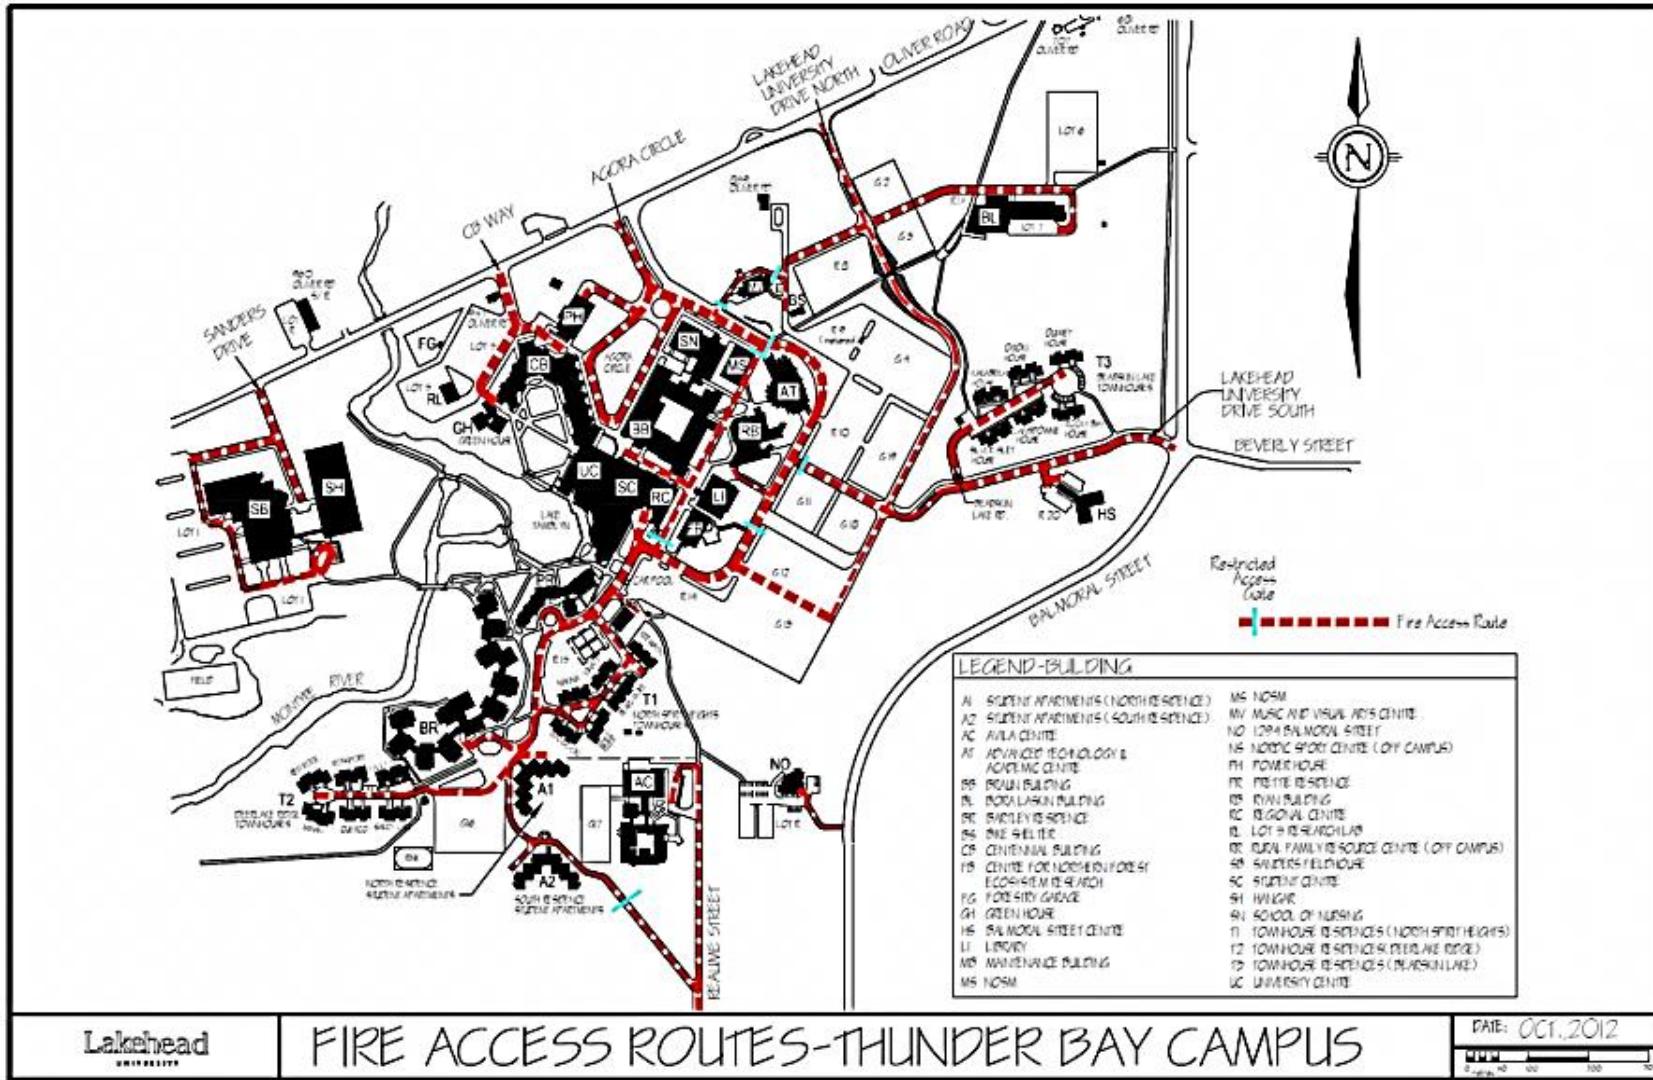


4.2 Site Plan

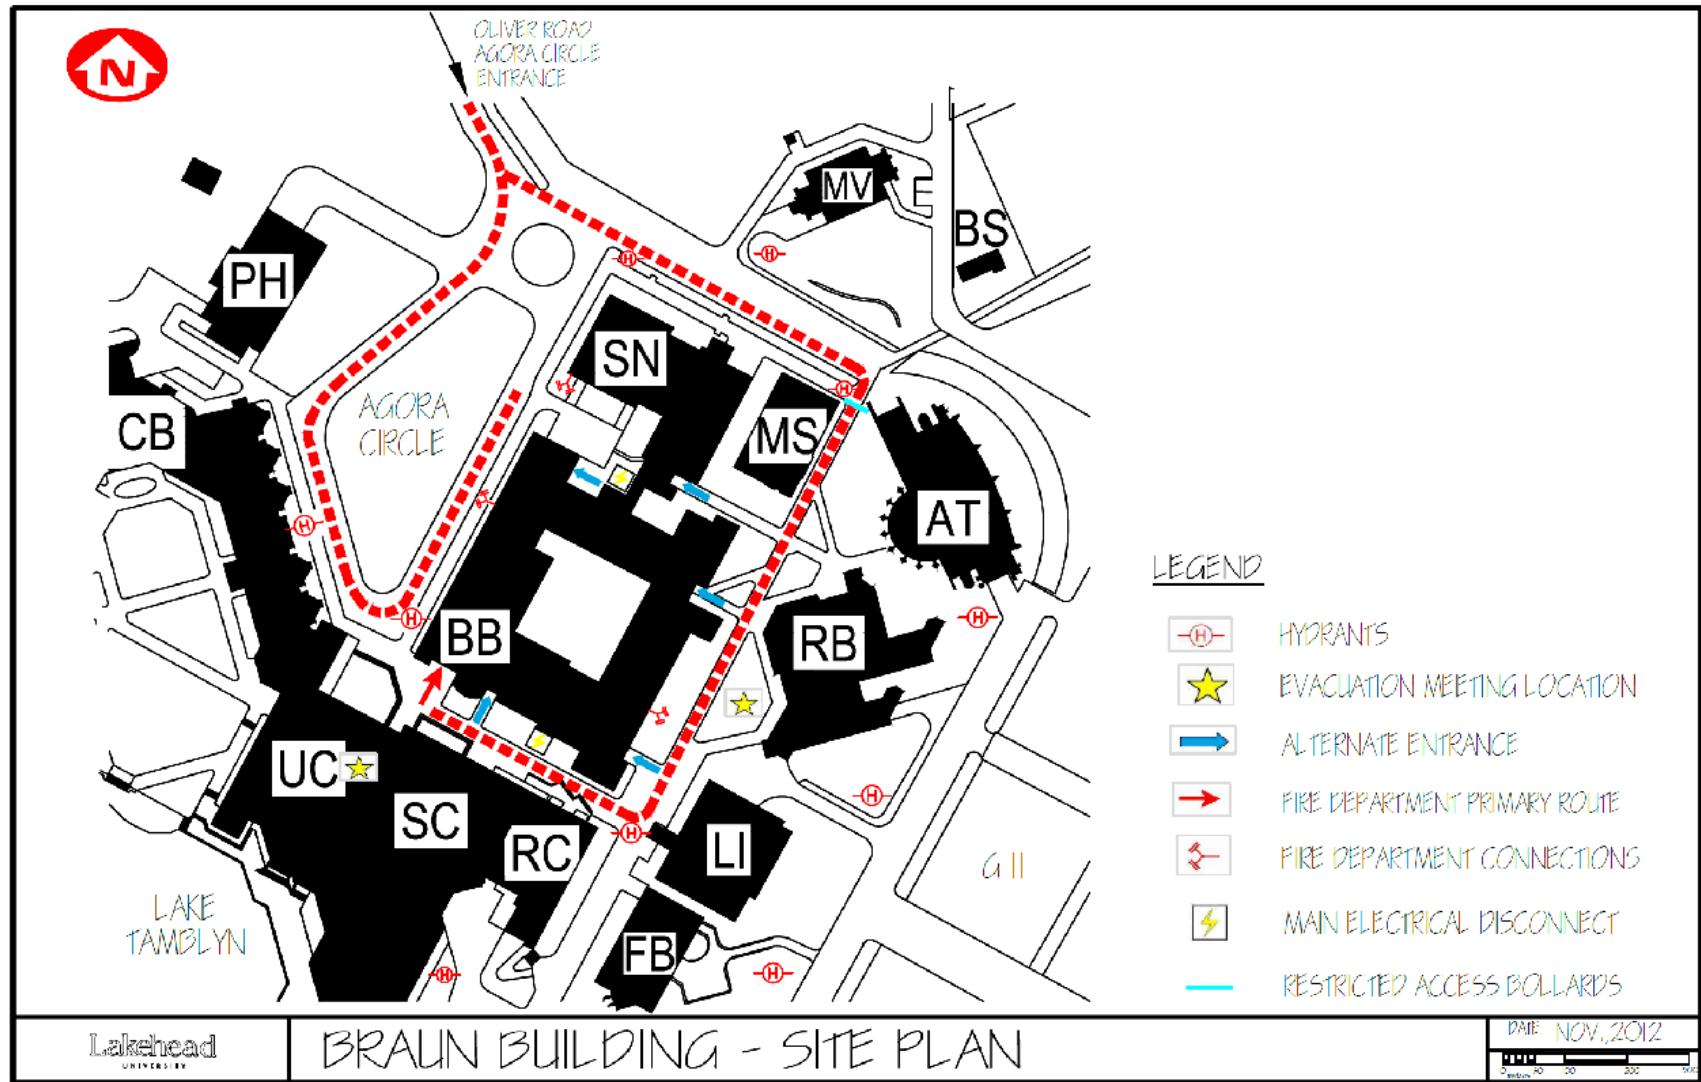


Fire Safety Plan: Braun Building

4.3 Main Floor Plan

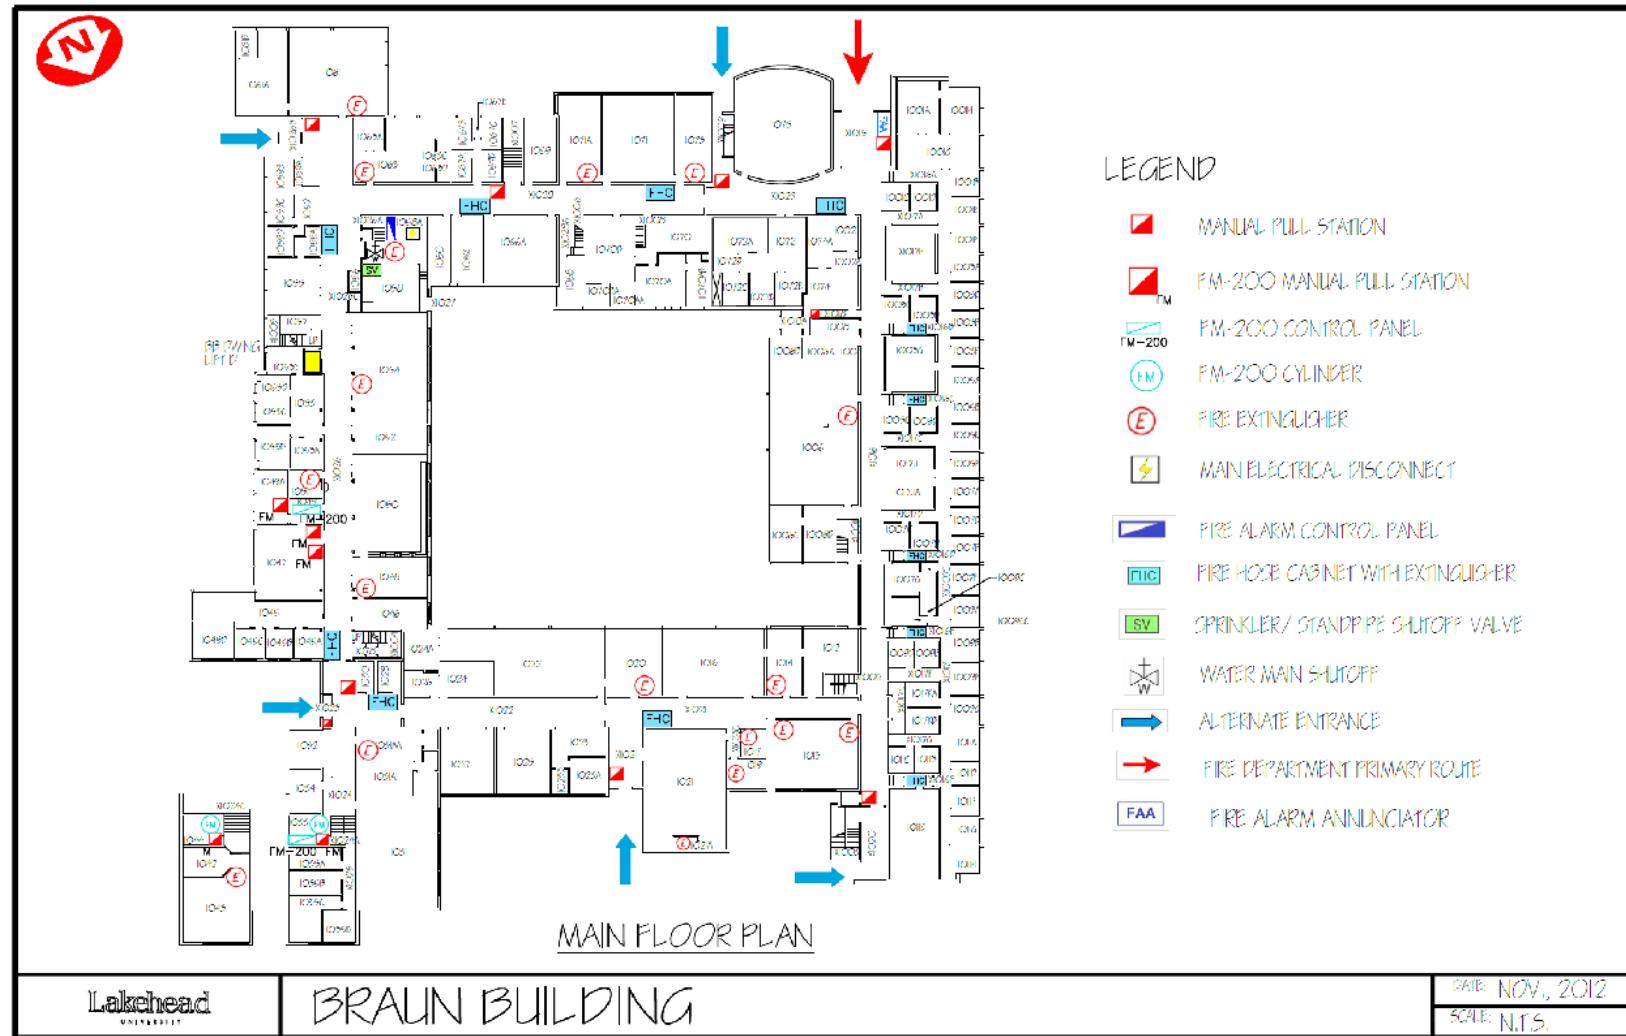

4.4 Second Floor & Basement Floor Plan

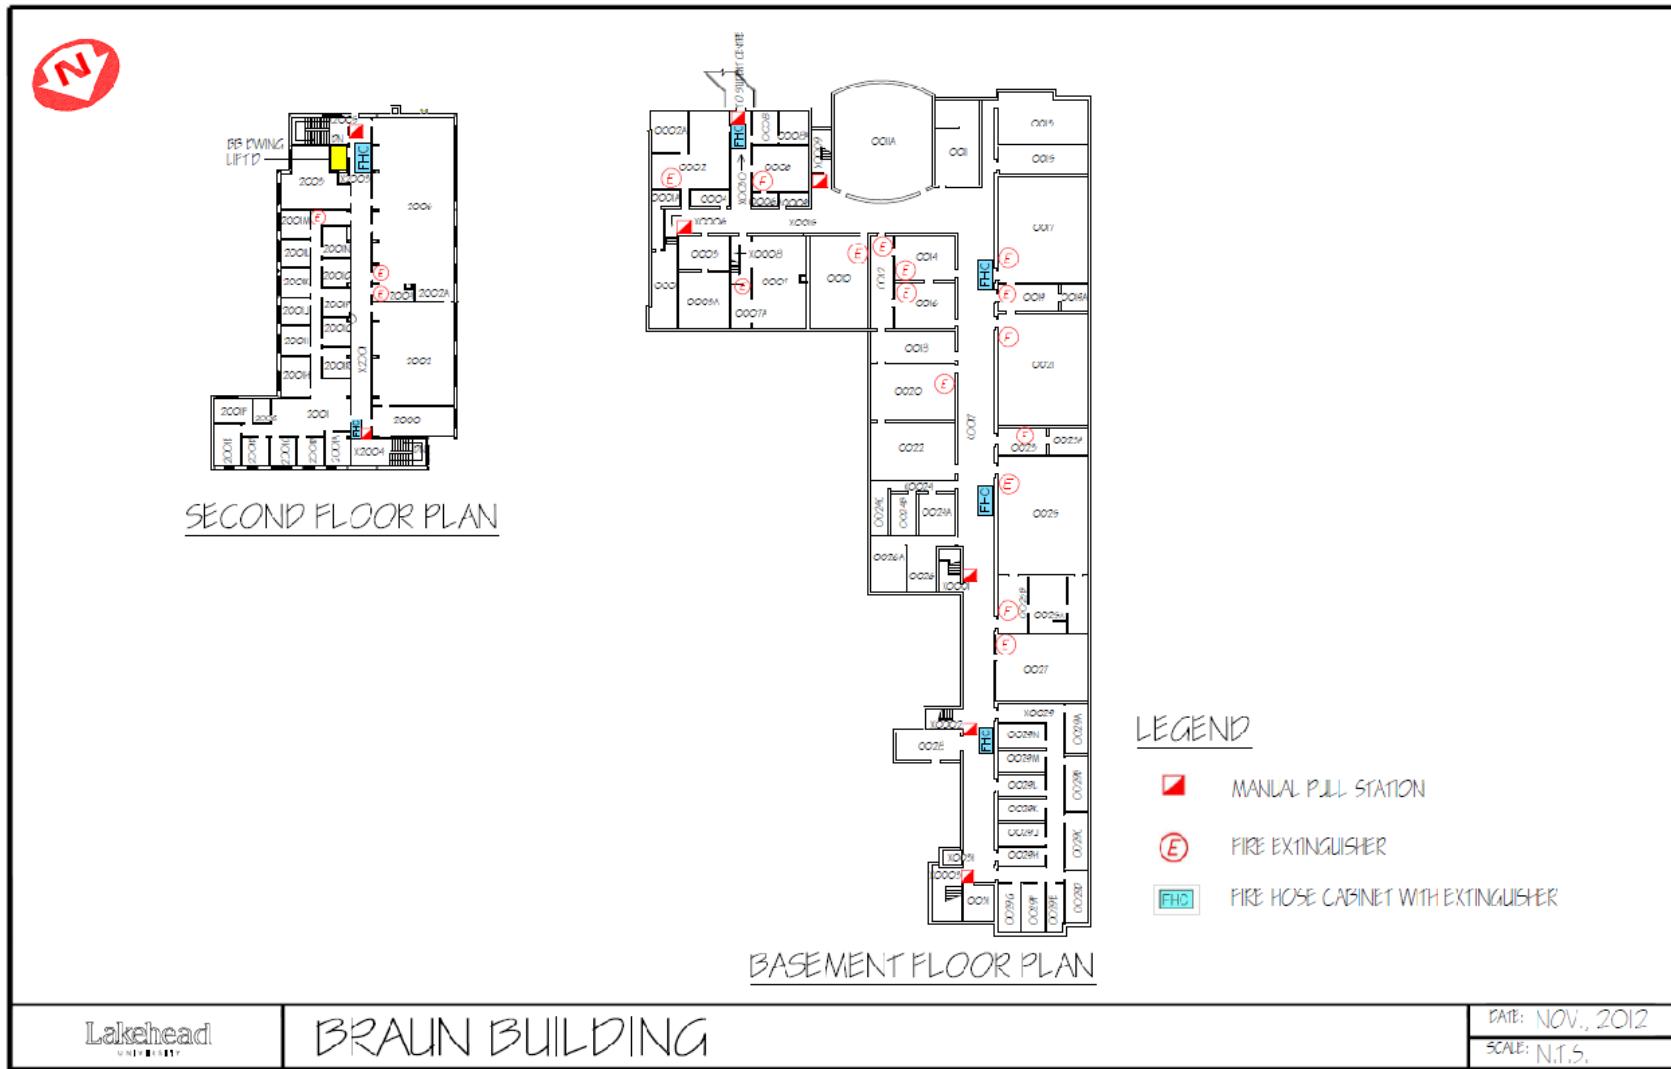

Chapter 5: Responsibilities & Emergency Procedures

The preparation and implementation of a Fire Safety Plan, helps to assure effective use of people and resources to control and eliminate fire hazards in the workplace and to respond effectively to a fire emergency. This will reduce the incidence of fire, protect life safety and reduce the impact of fire should one occur.

The procedures outlined in this Plan will be conducted with all due regard for personal safety

It is not the intent of this Plan to place a person in a hazardous situation that they are not trained or properly equipped for.

Many parties will have a role to play in promoting fire safety in the workplace. Each party will be responsible for certain administrative functions to be performed throughout the year. Some may be responsible for ensuring that tasks are carried out, while others may be responsible for carrying out those tasks.

5.1 Building Owner and Management (President, VP Finance & Administration)

The Ontario Fire Code defines “owner” as “any person, firm, or corporation having control over the property under consideration”. Article 1.2.1.1 of the Ontario Fire Code states, “Unless otherwise specified, the Building owner is responsible for carrying out the provisions of this Code”. Therefore, owners must take responsibility for ensuring compliance with the Ontario Fire Code. The building owner / occupant have numerous responsibilities related to fire safety and must ensure that the following measures are enacted:

- Comply with the Ontario Fire Code.
- Ensure the Fire Safety Plan is developed, approved and fully implemented.
- Keep a copy of the approved Fire Safety Plan on the premises in an approved location.
- Review the Fire Safety Plan annually and revise when changes occur that will affect the information therein, such as contact information or changes to the fire protection system.
- Notification of the Chief Fire Official regarding changes in the Fire Safety Plan.
- Establishment of emergency procedures to be followed at the time of an emergency.
- Post and maintain at least one (1) copy of the fire emergency procedures.
- Appointment and organization of designated supervisory staff (Managers, Maintenance staff, Security or Fire Wardens) to carry out fire safety duties.

- Instruction of supervisory staff and other occupants so that they are aware of their responsibilities for fire safety.
- Designate and train sufficient alternates to replace supervisory staff during any absence
 - “Supervisory staff shall be instructed in the fire emergency procedures as described in the fire safety plan before they are given any responsibility for fire safety”, as outlined in Section 2.8.1.2. (1) of the Ontario Fire Code.
 - It is not necessary that the supervisory staff be in the building on a continuous basis, but they shall be available on the notification of a fire emergency, to fulfill their obligations as described in the *Braun Building* Fire Safety Plan.
- Hold drills in accordance with the Ontario Fire Code and in consultation with the Chief Fire Official, incorporating Emergency Procedures appropriate to the *Braun Building*.
- Keep adequate records of training and fire drills for a period of at least one-year.
- Ensure that hazards are identified and eliminated or controlled.
- Maintenance of building facilities and ensure that building life safety and fire protection systems provided for occupant safety are maintained.
- Provisions of alternate measures for safety of occupants during shut down of fire protection equipment.
- Assuring that checks, test and inspections as required by the Ontario Fire Code are completed on schedule and that records are retained for a minimum period of two (2) years.

5.2 Employers, Managers and Supervisors

Employers are responsible for fire safety within their area of operation. Employers, Managers and Supervisors must:

- Comply with the Ontario Fire Code within the space you control or lease.
- Ensure that Fire Wardens have been designated and trained to carry out the duties assigned to them under this Plan. Contact Human Resources for a current list of building Fire Wardens.
- Identify key personnel in your department requiring fire extinguisher training. To arrange training contact the Office of Human Resources – Health & Safety (807-343-8010 Ext 8806).
- Review the fire emergency procedures outlined in this Plan with your employees.
- Ensure any person who requires assistance to evacuate the building is identified and that a specific plan is established in the event of an emergency. This plan will be formulated in consultation with the areas fire warden.
- Practice and encourage employees to participate in fire drills conducted in the building.
- Encourage employees to cooperate with Fire Wardens and Security staff as they provide direction during fire alarms and building evacuations.
- Respond to any requests to eliminate fire hazards.
 - Eliminate those departmental fire hazards which you can control.

- Report any fire hazards that you cannot control to Security, Physical Plant or another Supervisor or department (when another department is involved).
- Laboratory Supervisors shall prepare emergency plans for their work area. Address specific hazards in the facility.
 - Ensure that ALL students and staff who use the laboratory are trained and familiar with these procedures.
 - Proper signage must be displayed on exterior lab doors. Contact the Office of Human Resources – Health & Safety for guidance (807-343-8010 Ext 8806).

5.3 Physical Plant (Mechanical & Electrical Staff)

- Be familiar with the floor area, exits, the locations of any fire safety equipment and the sound of the building's fire alarm.
- Be familiar with the operation of all fire protection and life safety systems and equipment.
- Provide specific checks, tests, and inspection requirements of the Ontario Fire Code assigned to you, as summarized in Chapter 11 of this Plan.
- Notify the appropriate persons of any planned or unplanned shutdown of fire protection or life safety equipment.
- Assist in implementing alternate measures for fire safety to compensate for the inactive system, as outlined in the Chapter 9 of this Plan.
- Restore the fire protection and fire alarm systems to normal operation after repairs or maintenance are completed or as soon as you are authorized to do so after an emergency.
- Assist in fire prevention by controlling fire hazards and conditions of possible safety threats.
- Promptly address and correct any fire hazards reported to you.
- Physical Plant will be notified by Security of any fire drills taking place.

i. Emergency Procedures -Physical Plant Staff

Upon notification by Security Services that a fire alarm has been activated, Physical Plant staff will stand by for further instructions.

Electrical Staff will:

- Be notified of all fire alarms and attend the site of any actual fire emergencies, or if the fire alarm system cannot be reset by Security Services.
- Prepare to disconnect the electrical service to the affected area. Disconnection will be at the direction of the Fire Department.
- Request assistance of other Physical Plant Departments as needed.

5.4 Security

- Be familiar with the floor area, exits, the locations of any fire safety equipment and the sound of the building's fire alarm.
- Participate in fire drills as described in this Plan.
- Assist in fire prevention by controlling fire hazards and conditions of possible safety threats.
- Promptly report or correct any fire hazards you have been informed of.
- Provide specific checks, tests, and inspection requirements of the Ontario Fire Code assigned to you, as summarized in the Chapter 11 of this Plan.
- Notify the appropriate persons of any planned or unplanned shutdown of fire protection or life safety equipment.
- Assist in implementing alternate measures for fire safety to compensate for the inactive system, as outlined in Chapter 9 of this Plan.
- Be familiar with the procedures and operation of the Fire Alarm and Security Systems.
- Be familiar with your role upon notification of a fire alarm.
- Know where the Fire Plan is kept and how to access the buildings material safety data sheets.
- Security must have quick access to fire safety equipment (Fire Alarm Panel, generator room, pull station keys, elevator keys, and service/fire access roads).
- Be available to assist the Fire Department.

As with any emergency Fire Alarms will take priority over any other university business

i. Emergency Procedures- Security Services

Upon receiving notification of a fire alarm at the security office, you will:

1. Check the fire panel and print out for the exact location of the alarm.
2. Over the radio, notify the security personnel and dispatch all patrol officers to the appropriate building.
3. Call the monitoring company and verify they have received the alarm signal and have contacted the fire department.
4. Open electronic access gates if present on the buildings Fire Access Route.
5. Await further instructions from the Security Officers on the scene. Upon receipt of a report from the Security Officer on scene, the Security will:
 - a. Contact Fire Dispatch (807-684-1525) to provide specific information regarding the alarm.
 - b. Contact Physical Plant and Electrical staff (807-343-8010 Ext 8273) if there is a known fire.
6. Alert Human Resources at 807-343-8010 Ext 8806 or 807-343-8010 Ext 8671 or after hours using the Emergency Contact phone numbers filed with Security.
7. DO NOT touch the fire panel.

8. Any information received on the cause of the alarm will be relayed immediately to the Security Officers on scene.
9. Ensure the Fire alarm system is not silenced or reset until authorization is given by the Fire Department.

Upon notification of a fire alarm, Security Officers assigned to patrol will:

1. ONE officer will meet the Fire Department at the designated entrance.
 - a. Advise the Fire Department of any information regarding the cause of the alarm or details of the fire and relay any concerns regarding the zone affected (ie. Woodworking Shop or chemical storage).
2. ALL OTHER officers will immediately report to the area in distress and report to the other security personnel the condition of the site.
 - a. One officer will check the zone indicated by the annunciation panel as being in distress, if it is safe to do so. Report findings to the security office and indicate if there is a need for other services to be called (ie. Ambulance, Electrical, Mechanical). The officer will also report if there is an actual fire, smoke present or if the cause of the fire is known.
 - b. Ensure fire access routes are unobstructed (Remove any bollards and open gates).
 - c. One officer will control crowds and ensure that all persons are kept away from the building and the roadway is clear for the Fire Department. Ensure no one re-enters the building until the Fire Department has given the all clear.
3. Security officers will follow the instructions of the Fire Department personnel.
4. Once authorized by the Fire Department, Security Officers will silence the alarms, reset the activated device, return elevators to normal service, reset maglocks (if applicable) and provide the "All Clear" announcement to those who have evacuated the building.
5. Security will facilitate the Fire Department's investigation (if a fire occurred).
6. An incident report must be generated for ALL fire alarms, without exception.
7. Forward a copy of the report to the Office of Human Resources – Health & Safety.

Security Officers shall refer to a more detailed description of these procedures in the "Security Services Department Policy & Procedure Manual".

5.5 Fire Wardens

As with all major buildings on campus the Braun Building has designated Fire Wardens. Fire Wardens are individuals who volunteer or who are assigned to perform certain functions during fire emergency situations. Wardens can be identified during fire evacuations by their reflective vests

Fire Wardens will direct the evacuation of specific areas (zones) of their building during an emergency and assist with building security. Fire Wardens should be familiar with all potential exit routes, the fire protection measures and emergency procedures in the zone they are responsible for. Wardens will

assist in identifying personnel in their zone who may require assistance to evacuate, and ensure that plans are in place to ensure their safety.

Keep the reflective vest in an easily accessible location and ensure that an alternate Warden is informed of your absence. Health & Safety will arrange for training, organize and determine the number of Fire Wardens required for each zone. Contact Lakehead University Office of Human Resources – Health & Safety (807-343-8010 Ext 8806) for a current list of building Fire Wardens.

Fire Wardens will execute their duties with all due regard for their own personal safety

i. Emergency Procedures – Fire Wardens

On notification of a Fire Emergency, Fire Wardens will:

1. Identify yourself as a Fire Warden. Wear your vest.
2. Evacuate the area nearest the fire first, if known. Direct people to the nearest exit. If the exit is impassable, direct people to an alternate route.
3. Make a sweep of your assigned zone, checking all open rooms, including washrooms and storage rooms, to ensure everyone has left.
4. Close any open windows.
5. Close, but do not lock, doors in your zone
6. Note the name and/or location of any individuals who remain in the building to report to the Fire Department or Security Services staff.
7. Ensure persons who require assistance to evacuate or those who cannot evacuate are assisted down the exit stairs or to the nearest exit stair landing. See section 5.8 for more detail.
8. Once the zone has been evacuated, leave the building using the closest exit stair.
9. Once outside the building, direct evacuees to the designated meeting location (In front of the Agora or outside the Ryan Building). In cases of inclement weather, to an adjacent building and ensure Security Services is notified of your alternate location.
10. Immediately notify the Fire Department personnel or Security Services staff of the location and/or name of any individuals who remained in the building and disclose any other information regarding the location or nature of the fire.
11. If Fire Department personnel are not on the scene, confirm with Security Services that the Fire Department has been notified.
12. Assist the Fire Department personnel and Security Services staff, as requested.
13. Stay at the front of your group and keep people well back from the building. Stay visible and do not mingle with the crowd.
14. Obtain information from evacuees in your area. If anyone has information for the Fire Department or Security Services staff, ensure that it is reported.

15. The end of the Fire Alarm signal DOES NOT indicate that it is safe to re-enter the building.
Ensure that no one re-enters the building until the all clear signal has been given by Security Services staff or Fire Department personnel.
16. After the fire emergency or fire drill is over, report any problems encountered during the evacuation to the Office of Human Resources- Health & Safety at 807-343-8010 Ext8806.

5.6 Evacuation Meeting Locations

The designated evacuation meeting location for the *Braun Building* is in front of the Agora or outside the Ryan Building.

All persons evacuating the *Braun Building* must immediately report to the designated location and report to their zones Fire Warden or their Instructor.

5.7 Teachers and Instructors

Teachers and Instructors should act as Fire Wardens for their lecture halls or studios.

To prepare for a fire emergency, be familiar with the floor area, location of exits and evacuations routes. Make note of any persons in your lecture hall or studio who may require assistance to evacuate and be familiar with proper procedures for turning off equipment.

Ensure that any fire hazards in your lecture hall or studio are identified, controlled, or reported to your Supervisor, Physical Plant (807-343-8010 Ext 8273) or Health & Safety (807-343-8010 Ext 8806). Ensure that you and your students participate in fire drills and follow the directions of Fire Wardens, Security Services and the Fire Department.

i. Emergency Procedures – Teachers and Instructors

1. Upon notification of a fire, instruct all students to calmly evacuate the building and announce the location of the nearest exit stair.
2. All equipment that cannot be left safely unattended should be turned off.
3. Close any open windows.
4. Conduct a systematic check of your immediate area for anyone who has not evacuated and look for fire or smoke.
5. Follow the last student from the room shutting all doors behind you. Do not lock.
6. Ensure persons who require assistance to evacuate or those who cannot evacuate are assisted down the exit stairs or to the nearest exit stair landing. See section 5.8 for more detail.
7. Leave the building using the closest exit stair, closing doors behind you. Do not use elevator.
8. Follow instructions provided by Fire Wardens, Security Services and the Fire Department.

9. Report to Security Services or the Fire Department if you know of anyone still in the building, or if you saw smoke or fire.
10. Move away from the building and congregate at the designated meeting location (In front of the Agora or outside the Ryan Building).
11. Obtain information from evacuees in your area. If anyone has information for the Fire Department or Security, ensure that it is reported.
12. Do not return to the building until authorized to do so by the Fire Department, Security or a Fire Warden.

5.8 Persons Requiring Assistance to Evacuate

Persons requiring assistance to evacuate are encouraged to identify themselves to their Supervisor or to their Instructors upon commencing employment or classes at Lakehead University. It is the responsibility of Lakehead University to ensure that persons requiring assistance to evacuate are provided with means to leave the premises safely. Faculty and Administration should be aware if there are individuals in their classes or department who require assistance in the event of a fire emergency.

Any special arrangements made for persons requiring assistance to evacuate should be reviewed in advance with the Supervisor or Instructor and the Fire Warden responsible for the zone(s).

For those persons who are unable to evacuate, Fire Wardens, Instructors and Supervisors must know:

- Where a person can be safely left in the eventuality that evacuation from the building is not possible.
- The procedure for reporting the location of persons left in the building to the Fire Department or Security Services.

Immediately inside the exit stair is the best location to await rescue, in the event that evacuation is not possible. Exit stairs are enclosed fire protected stairwells with fire resistant walls and doors designed to protect from smoke and fire. **Be familiar with the evacuation plan.**

i. Emergency Procedures- Persons Requiring Assistance to Evacuate

On notification of a Fire, a Supervisor, Instructor or Fire Warden who is aware that a person with requiring assistance to evacuate is present in their workplace or classroom will:

1. Ensure that the individual has been notified.
2. Carry out your regular duties: instruct all occupants to evacuate via the nearest exit, conduct a systematic check of the immediate area and turn off all equipment if safe to do so.
3. If the individual requiring assistance to evacuate has not made alternate plans for evacuation , the following procedure will be followed:

- a. The Supervisor, Instructor or Fire Warden will help any person requiring assistance in reaching a safe location outside the building using an exit stairwell, insofar as they are able to do so.
 - i. Persons requiring assistance should be moved into the exit stair when there is a break in the flow of persons evacuating, or when the stair is clear.
 - ii. If the person is unable to continue while descending, stop at the next door encountered on the way down. Do not obstruct others who are evacuating.
 - iii. Station the person immediately inside the stairwell, if safe to do so, call Security (807-343-8911, extension 8911 or a blue emergency telephone) or exit the building and immediately inform Security Services or the Fire Department of the person's location.
- b. To assist individuals who are unable to evacuate using the stairs, the Supervisor, Instructor or Fire Warden will ensure the person requiring assistance is moved to the nearest exit stairwell landing.
 - i. Persons who cannot use the stairs are to remain inside the exit stairs, ensuring that the exit stair door remains closed.
 - ii. Any person who wishes to stay with the individual may do so.
 - iii. Contact Security (807-343-8911, extension 8911 or a blue emergency - telephone). If a phone is not available exit the building and immediately inform Security Services or the Fire Department of the person's location.

Those who have begun providing support must ensure the person requiring assistance has been safely evacuated before resuming their regular duties

5.9 All Occupants

All occupants must be familiar with Lakehead University Emergency Procedures to be followed upon discovery of smoke or fire and upon hearing the fire alarm. Occupants will also participate in all fire drills and other fire safety training prescribed by Lakehead University.

Notify your Supervisor, Fire Warden or Instructor if you have a condition that you feel may inhibit your ability to evacuate the building safely without assistance. If you are assigned to assist someone to evacuate, ensure that you know the procedures to be carried out. Make note and report any fire hazards or unsafe conditions observed in the building. Refer to Chapter 7 for more details.

i. Emergency Procedures- All Occupants

Upon Discovery of Fire or Smoke

1. Leave the fire area immediately. Remove any person in immediate danger. Ensure that all doors to the affected area are closed to confine the fire. Do not lock.

2. Warn people in the area to evacuate.
3. Activate the fire alarm using the nearest pull station.
4. Leave the building using the closest exit stair, closing doors and open windows behind you. Do not use the elevator.
5. Once at a safe location call 807-343-8911, extension 8911 from a campus phone or use the blue emergency telephone.
6. Follow instructions provided by Fire Wardens, Security staff and the Fire Department.
7. Report to Security staff or the Fire Department if you know of anyone still in the building.
8. Move away from the building and congregate in the designated meeting location (In front of the Agora or outside the Ryan Building).
9. Do not return to the building until authorized to do so by the Fire Department, Security, or a Fire Warden.

On Notification of a Fire

1. Evacuate the building immediately using the nearest exit stair.
2. Leave the building using the closest exit stair, closing doors and open windows behind you. Do not use the elevator.
3. Follow instructions provided by Fire Wardens, Security staff and the Fire Department.
4. Report to Security staff or the Fire Department if you know of anyone still in the building, or if you saw smoke or fire.
5. Move away from the building and congregate in the designated meeting location (In front of the Agora or outside the Ryan Building).
6. Do not return to the building until authorized to do so by the Fire Department, Security or a Fire Warden.

5.10 Extra Precautions While Exiting

1. Check all doors before opening them using the back of your hand.
 - a. If the door is hot, do not open it. Use an alternate path to exit.
 - b. If the door is not hot, brace yourself against it and open it slightly, standing to one side. If you detect fire or smoke, feel air pressure or a hot draft, close the door quickly, leaving it unlocked. Use an alternate path to exit.
2. If an exit route is not available or you are trapped:
 - a. Return to a “safe room” (ie. an office) and close the door, leaving it unlocked.
 - b. Seal off all openings which may admit smoke.
 - c. Crouch low to the floor if smoke enters the room.
 - d. Call Security at 807-343-8911 or extension 8911 and alert them to your location. Wait to be rescued.
 - e. If a phone is not available get the attention of emergency personnel by any means available to you (shout, wave from a window, etc.).

- f. Listen for instructions given by authorized personnel.
3. If you encounter smoke while exiting and an alternate exit or a “safe room” is not available, drop to your knees and crawl towards the closest exit stair.

5.11 Special Evacuation Procedures

i. Fire Alarms During Examinations

1. Turn your examination over.
2. Evacuate the building using the nearest exit stair. Do not use the elevator.
3. Follow the directions of your Instructor, Fire Wardens, Security staff and the Fire Department.
4. Move away from the building and congregate in the designated meeting location (In front of the Agora or outside the Ryan Building).
5. Do not return to the building until authorized to do so by the Fire Department, Security or a Fire Warden.

ii. Contractors & Cleaning Staff

1. As long as it is safe to do so, turn off any equipment you are using and ensure that it is not left in such a way as to block exits.
2. Evacuate the building using the nearest exit stair. Do not use the elevator.
3. Follow the directions of Fire Wardens, Security staff and the Fire Department.
4. Ensure that the building staff are aware that you have evacuated
5. Move away from the building and congregate in the designated meeting location (The Agora or outside the Ryan Building).
6. Do not return to the building until authorized to do so by the Fire Department, Security or a Fire Warden.

5.12 Laboratories

Laboratory facilities will remain locked when unsupervised. Access will be restricted to authorized personnel only. Prior to being granted access, authorized personnel receive training appropriate to the hazards present in the laboratory and will be familiar with emergency response protocols.

Students and Staff must review safe use of chemicals and fire safety plans with their Supervisor prior to starting work in the lab and as often as necessary to ensure familiarity with safe working practices

i. Working Safely

Storage Areas- Flammables

- All personnel working in laboratories must be trained in the safe handling of flammable and combustible liquids.
- Those working with hazardous chemicals are required to be familiar with the use and handling of chemicals as outlined in the applicable Safety Data Sheets (SDS).
- All flammable liquids are kept in an Ontario Fire Code OReg 213/07 approved flammable cabinet, except for quantities required in one day's work.
- All flammable cabinets must conform to ULC-C1275, ULI 1275, be FM approved, or meet NFPA 30 standard.
- Quantities of flammable and combustible liquids greater than 300L must be stored in a designated and approved chemical storage room.
- Ensure that flammable materials are stored in approved containers or cabinets and their lids tightly closed.
- As outlined in the Ontario Fire Code, approved containers are those built in conformance with the Transportation of Dangerous Goods Regulations or ULC/ORD-C30, Safety containers.
- Do not use open flame to heat a flammable liquid or to carry out a distillation under reduced pressure.
- If an open flame is necessary, ensure there are no flammable substances or vapours present in the immediate area. Extinguish the open flame when it is no longer needed and NEVER leave an open flame unattended.
- When volatile flammable materials are present, use only non-sparking equipment.
- Discard flammable or combustible waste into approved waste containers only.
- Restrict the quantity of flammable liquids stored in approved glass or metal containers to 5 litres, as per the Ontario Fire Code.
- Storage areas must be kept clean, organized and free of debris.
- For more detail see Section 7.8

Safety storage of compatible chemicals

- Chemicals are stored by reactive class and incompatible chemicals are physically separated from each other.
- **Flammable and combustible liquids** will not be stored with corrosives, oxidizers, reactive chemicals, or compressed gases.
- **Acids** are separated from caustics and from reactive metals such as sodium, magnesium and potassium.
- **Oxidizers** are stored away from organic acids, flammable, combustible and reducing agents (e.g. zinc, alkaline metals) and should not be stored on combustible surfaces.
- **Water reactive** chemicals are stored in a cool, dry place. In case of fire, a Class D fire extinguisher is used.

- Hazardous chemicals shall not be stored in areas used for ordinary combustible materials (ie. Paper or cardboard boxes) or exposed to direct sunlight or localized heat.
- Safety Data Sheets (SDS) for each chemical must be consulted for proper storage instructions and should be accessible to the storage area.

Refer to SDS for specific incompatibilities

For more detailed information refer to Lakehead University's "Chemical Storage Procedure" found on the Health & Safety website. <http://hr.lakeheadu.ca/wp/?pg=140>

Electrical Safety

- Electrical wiring that is defective, frayed or cracked must be replaced. Discontinue use and contact physical plant (807-343-8010 Ext 8273) immediately upon discovery of damaged electrical wiring.
- Extension cords must be unplugged after use and cannot be used as permanent wiring.
- Power bars are acceptable for long term use, provided they are used safely.
- In order to control risk of fire and/or electrocution all lab equipment must be CSA or ULC approved for safe use in Ontario.
- Safe use of power bars and accepted certification marks can be reviewed on Lakehead University's Health & Safety website. <http://hr.lakeheadu.ca/wp/?pg=140>

ii. Emergency Procedures - Laboratories

For laboratories it is important to develop emergency shutdown procedures for processes which may create hazards when unattended. For example,

If safe to do so:

- Turn off equipment that cannot be safely left unattended
- Turn off any natural gas taps in use
- Close the sash of the fume hood
- Cover and/or secure open containers of flammable chemicals or biohazardous agents.
- Remove personal protective equipment prior to evacuating.

Supervisors must develop emergency procedures to address any specific hazards in their laboratories and ensure staff and/or students are trained and familiar with these procedures. Below are basic laboratory fire emergency procedures which Supervisors should adapt.

1. As long as it is safe to do so:
 - a. Turn off any equipment that cannot be safely left unattended.
 - b. Turn off any open natural gas taps and secure hazardous materials in use.
 - c. Shut any open windows or doors.

2. Remove your personal protective equipment prior to exiting.
3. Instruct any persons you encounter to evacuate the building using the nearest exit stair. Do not use elevators.
4. Follow the directions of your Supervisor, Fire Wardens, Security staff and the Fire Department.
5. Report to Security or the Fire Department if you know of anyone still in the building or have any details regarding the fire.
6. Move away from the building and congregate in the designated meeting. Refer to the site plan, Section 4.2, for more detail.
7. Do not return to the building until authorized to do so by the Fire Department, Security or a Fire Warden.

In the case of fire or explosion, immediately turn off burners and other heating devices and stop reactions in process, if it is safe to do so. Activate the fire alarm, call 807-343-8911 (extension 8911) from a safe distance and follow the emergency procedures outlined in this Plan or on the emergency procedures flip book.

5.13 Storage and Collection Room (Anthropology)

The Anthropology department has a number of storage and collections rooms. Storage and collection rooms will be kept neat, organized and free of debris so that its contents do not pose a safety hazard. (Items neatly stacked to avoid creating a tipping hazard, storage items must not be in contact with electrical outlets, no electronics in use). Importantly, all means of egress must be kept clear of storage items or rubbish. Review section 7.7 for more detail.

5.14 Technology Services Centre (TSC)

All staff and users must complete a safety induction with TSC supervisors prior to being sanctioned to work in their licensed areas. Only sanctioned users will be permitted entry. Users must abide by the security and safety measures established by TSC.

- All staff and client organizations are responsible for reporting any unacceptable conditions to the contact person.
- Do not store any paper, packaging products or other combustible materials of the kind in the licensed areas.
- Do not bring any food beverages, hazardous materials or other items prohibited by TSC into the licensed areas.

In the event of a confirmed fire in the *Braun Building* TSC management will be informed of the event using the emergency contact form filed with Security Services.

5.15 Hazardous Materials Emergencies

It is the responsibility of the Supervisor in each area to have appropriate spill kits available wherever hazardous materials are used or stored. In all cases of spills, attempts will be made (if safe to do so) to

prevent spill material from contacting equipment, infrastructure and being released into the environment (sinks, drains, open ground).

i. Minor Chemical Spills

Response to minor chemical spills which pose no immediate threat to health, environment or damage to property, as follows:

1. Notify occupants in the immediate area of the spill.
2. Use spill kits to absorb/contain spill.
3. If unpleasant odours are generated call 8911 (807-343-8911)
4. Place waste in a sealed container in a secure, well ventilated area.
5. Call Human Resources 8806 (807-343-8010 Ext 8806) or 8671 (807-343-8010 Ext 8671) to arrange for chemical waste disposal.

ii. Major Chemical Spills

Response to major chemical spills, or spills which pose a threat to health, environment or damage to property, as follows:

1. Evacuate the immediate area, turning off spark-producing equipment and extinguish flames if flammable chemicals were spilled.
2. Assist contaminated persons with use of emergency eyewash or shower.
3. From a safe location, call 8911 (807-343-8911). Identify the chemicals involved, quantity spilled and hazards.
4. Wait in a safe location and keep unauthorized staff out of the contaminated area.

A copy of the chemical spill procedures are found in Lakehead University's "Emergency Procedures & Information" flipbook, posted throughout the campus and in every room that contains hazardous materials. The flipbook contains information regarding many hazardous or emergency situations and will be updated as required. All users of hazardous materials MUST be familiar with the Safety Data Sheet (SDS) prior to use.

5.16 Fire Service Elevator-Operation Instructions

It should be noted that Fire service elevators DO NOT have pressurized hoist ways. Firefighters should have a breathing apparatus with them. A FEO1 key is required to operate or reset the Fire Service elevator. Security Services can provide firefighters with a FEO1 key upon request.

i. Phase 1 Operation

- Recall to the designated floor is initiated by the fire alarm or the key switch in the hall panel.
- The elevator will remain at the recall floor with doors open, out of service.

ii. Phase 2 Operation

- To initiate Phase 2 (Fire Service) the FEOK1 key will be used to open the firefighters service panel inside the elevator.
- Once open, the key will be inserted into the key cylinder inside the panel and turned to the 'ON' position.
- To operate on Phase 2 (Fire Service) a call would be registered by pressing the floor number.
- The doors are closed by holding the "door close" button inside the panel until the doors are completely shut.
- The elevator will travel to the requested floor but will not open doors.
- To open the doors hold the "door open" button inside the panel until the doors open completely.
- Doors will remain open until closed by the operator using the "door close" button inside the panel, as before.
- Repeat to travel to any additional floors.

iii. Return to Phase 1

- To return to Phase 1 the key inside the firefighters panel would be turned to the off position.
- The elevator will recall to the designated floor landing and will open doors.
- The elevator will remain on the recall floor with doors open and out of service.
- Return to normal automatic operation by using the FEOK1 key in the hall station. Turn the key to the reset position and back to off.

Chapter 6: Fire Extinguishment, Control or Confinement

In the event of a small fire, first ensure that the Fire Alarm System has been activated and dial extension 8911(807-343-8911) to ensure that the Security Office have been notified prior to any attempt to extinguish a fire. Security officers will report to Emergency dispatch (911) any specifics details concerning the location and nature of the fire.

Fighting a fire is always a voluntary act

Only those persons who are trained and familiar with extinguisher operation may attempt to fight a fire. In the event a small fire cannot be extinguished with the use of a portable fire extinguisher or the smoke presents a hazard for the operator, the door to the area should be closed to confine and contain the fire. Leave the area.

6.1 Suggested Operation of Portable Fire Extinguishers

Remember the acronym **P.A.S.S.**

Pull the safety pin

Aim the nozzle

Squeeze the trigger handle

Sweep from side to side (watch for fire restarting)

Never re-hang extinguishers after use. Contact Security Services (807-343-8010 Ext 8569) to ensure that they are properly recharged by qualified personnel. Security services will also ensure that a replacement extinguisher is provided.

Keep extinguishers in a visible area without obstructions around them.

6.2 Classification of Fires

Fires are classified according to the fuel type involved.

Class “A” fires are those fuelled by combustible solids, such as wood, paper, excelsior, rags and rubbish.

Class “B” fires occur in the vapour-air mixture over the surface of flammable liquids, such as gasoline, oil, grease, paints and thinners.

Class “C” fires occur in or near live electrical equipment.

Class “D” fires occur with pyrophoric (combustible) metals such as magnesium, titanium, lithium, sodium, potassium, etc.

Class “K” fires involve cooking oils or fats, such as those found in a deep fryer.

6.3 Classification of Fire Extinguishers

Portable fire extinguishers are classified according to their ability to handle specific classes of fires.

Labels on the extinguisher indicate the class or classes of fire that they can be expected to extinguish.



Extinguishers suitable for class "A" fires are identified by a triangle containing the letter "A"



Extinguishers suitable for class "B" fires are identified by a square containing the letter "B"



Extinguishers suitable for class "C" fires are identified by a circle containing the letter "C"



Extinguishers suitable for class "D" fires are identified by a star containing the letter "D"



Extinguishers suitable for class "K" fires are identified by a hexagon containing the letter "K". Class K extinguishers must ONLY be used on cooking fires (ie. The deep fryer)

In the Braun Building only class "A", "BC" and "ABC" extinguishers are provided.

Chapter 7: Fire Hazards and Fire Prevention

Fire Prevention is everyone's responsibility

If you notice a potential fire hazard report it to your supervisor or Health & Safety (807-343-8010 Ext 8806) immediately. Every precaution shall be taken to minimize accidents and prevent injuries.

7.1 Housekeeping

- Maintain safe escape routes by keeping exits, stairwells, hallways, windows, aisles and corridors free from obstructions and combustible materials.
- Ensure both sides of a door are kept free and clear of debris. Be particularly aware when you share a door with another department.
- Tables, equipment and other materials and installations may be placed in corridors only with the approval of the Fire Department. For further information contact Health & Safety at 807-343-8010 Ext 8806 or Physical Plant at 807-343-8010 Ext 8273.
- Regularly clear out combustible materials, such as waste paper and cardboard boxes. Review dead files and dispose of waste material.

- Emergency exits are marked by the lighted "EXIT" signs. Report any burnt out exit lights to Physical Plant at 807-343-8010 Ext 8273 or to Security 807-343-8010 Ext 8569 after hours.

7.2 Fire Doors

- Keep fire doors closed. If you find a fire door propped open, discard the wedge so it cannot be reused.
- Some fire doors are held open using electromagnetic devices. All hold open devices in the building will be released on activation of the fire alarm system. If you notice any problems with the electromagnetic hold open devices contact Physical Plant at 807-343-8010 Ext 8273 immediately.

7.3 General Hazards

- Do not use open candles or open flames.
- Smoking is prohibited on university property, except in designated smoking area.
- Place posters or decorations on bulletin boards. Never leave anything flammable in the corridors, stairwell or any means of egress.
- Do not hang decorating material from ceilings and keep streamers and banners to a minimum.
- Avoid placing combustible materials directly in contact with an electrical outlet.
- Ensure proper disposal of oily rags.

7.4 Electrical Hazards

- All electrical equipment, electrical lights used for decorations and extension cords must be CSA or ULC approved. Accepted certification marks can be reviewed on Lakehead University's Health & Safety website. <http://hr.lakeheadu.ca/wp/?pg=140>
- All electrical work must be done by a licensed electrician with Physical Plant (807-343-8010 Ext 8273).**
- Electrical wiring that is defective, frayed or cracked must be replaced. Discontinue use and contact physical plant (807-343-8010 Ext 8273) immediately upon discovery of damaged electrical wiring.
- Outlets and electrical devices that show evidence of electrical arcing will mean discontinuation of use until a qualified electrician from Physical Plant can assess the problem.
- If a circuit breaker consistently "trips", discontinue using the device that is causing the circuit to trip. Contact a licensed electrician from Physical Plant to assess the electrical system.
- Circuit breaker panels shall not be covered or obstructed by stored material. 1 meter clearance is required.
- Electrical equipment located where flammable or combustible liquids are present shall conform to the Electrical Safety Code made under the Electricity Act, 1998.

In Ontario it is ILLEGAL to connect unapproved equipment to an electrical supply

7.5 Extension Cords

- Extension cords are designed for temporary use only. Never should they be used as permanent wiring.
- Assure that extension cords used are of the proper rating to accept the required electrical load.
- Protect extension cords from damage and do not run them under mats or carpets. For long term use, extension cords must be replaced with a power bar or installed permanent wiring.
- Power bars are acceptable for long term use, provided they are used safely. Review safe use of power bars on Lakehead University's Health & Safety website.

<http://hr.lakeheadu.ca/wp/?pg=140>

7.6 Space Heaters and Appliances

- Space heaters are to be used with care, at least 1 meter away from combustible materials and must NEVER be left unattended.
- Seasonal trees must be flame retardant and ULC certified.
- Turn off or unplug any appliances or decorative lights before you leave.
- **All electrical appliances with heating elements (kettles, coffee makers, space heaters) must have an automatic shut-off function.**

7.7 Storage Areas

- Storage areas must be kept clean, organized and free of debris.
- Stacked material must be arranged so that the piles are stable and not at risk of tipping over.
- Light fixtures should be protected by wire guard or cage to prevent damage of light bulbs.
- Material should not be stored directly touching an electrical outlet.
- Electrical equipment and devices should not be operated, or connected to an electrical source in storage rooms.
- Doors to storage rooms shall be kept closed at all times.
- Service rooms should not be used for storage.
- Combustible material will be stored only in approved areas (see Section 7.8)
- Flammable and combustible liquids, hazardous, reactive, or unstable chemicals shall not be stored in rooms used for ordinary combustible materials (ie. Paper or cardboard boxes).

7.8 Flammable and Combustible Liquids

- All personnel working in laboratories must be trained in the safe handling of flammable and combustible liquids.
- Those working with hazardous chemicals are required to be familiar with the use and handling of chemicals as outlined in the applicable Safety Data Sheets (SDS).
- Ensure that flammable materials are stored in approved containers or cabinets and their lids tightly closed.

- As outlined in the Ontario Fire Code, approved containers are those built in conformance with the Transportation of Dangerous Goods Regulations or ULC/ORD-C30, Safety containers.
- If an open flame is necessary ensure there are no flammable substances or vapours present in the immediate area. Extinguish the open flame when it is no longer needed and NEVER leave an open flame unattended.
- When volatile flammable materials are present, use only non-sparking equipment.
- Discard flammable or combustible waste into approved waste containers only.
- Do not store flammable and combustible liquids with corrosives, oxidizers, reactive chemicals or compressed gases.
- Restrict the quantity of flammable liquids stored in approved glass or metal containers to 5 litres, as per the Ontario Fire Code.
- All cabinets and refrigerators containing flammable or combustible liquids shall be clearly identified.
- All flammable and combustible materials will be declared on the laboratories hazardous materials sign, posted on all exterior lab doors.

In the case of fire or explosion, immediately turn off burners and other heating devices, if it is safe to do so. Activate the fire alarm, call 807-343-8911 (extension 8911) from a safe distance and follow the emergency procedures outlined in this Plan or on the emergency procedures flip book.

There are specific regulations pertaining to handling, using or storing flammable or combustible liquids in Laboratories. Contact the Office of Human Resources-Health & Safety at 807-343-8010 Ext8806 for additional information.

7.9 Compressed Gas

- Storage of compressed gas cylinders will be in designated areas only and must conform to the Ontario Fire Code O.Reg. 213/07.
- Cylinders will not under any circumstances be stored in aisles, hallways, doorways, stairwells or exits.
- Cylinders must be secured with a chain at all times whether they are full or empty.
- Any area where compressed gas is stored MUST have signage on the doors depicting the hazard, type of gases and contact information of the person in authority.
- All compressed gases will be declared on the laboratories hazardous materials sign, posted on all exterior lab doors.

7.10 Hot Works

Hot works, such as welding, will be conducted by approved staff only following approved procedures. Contact Physical Plant at 807-343-8010 Ext 8273 for more information or to request a permit for hot work.

7.11 Special Events

i. Portable Cooking Devices

Any portable cooking devices will comply with the Ontario Fire Code and meet the standards set by the Fire Department. Cooking must not release any grease laden vapours.

Any portable cooking device must meet the following requirements:

1. Be annually certified by a TSSA (Technical Standards & Safety Authority) technician.
2. Have an operable, up-to-date, portable fire extinguisher with a minimum rating of 2A-10Bc with the appliance and readily available for use at all times.
3. Have the Fire Department certification sticker conspicuously displayed on the appliance. This sticker will bear the current year to be valid.

Chapter 8: Fire Protection Measures

8.1 Fire Alarms & Pull Stations

The *Braun Building* is equipped with fire alarm pull stations. Look for pull stations as you approach an exterior exit or a stairwell leading outside. The pull station will generally be located in the corridor adjacent to the exterior door leading to the vestibule or the stairwell, or located inside the vestibule itself. Refer to building drawings in Chapter 4.

8.2 Fire Extinguishers

The *Braun Building* is equipped with fire extinguishers. The extinguishers are either wall mounted, or located in the fire hose cabinets in the hallways. Extinguishers are checked monthly. If you discharge an extinguisher, or find one that has been discharged, contact Security at 807-343-8010 Ext 8569 and request a replacement.

8.3 Emergency Exits

Emergency Exits are marked by lighted signs with the word "EXIT". Exit signs are located high on the wall above ground level doors, or at stairwells leading to ground level exit doors. Lighted directional signage is also provided, where required. An outlined arrow appearing below the word "EXIT" indicates the direction to the closest emergency exit. Following these signs will provide an exit route during an emergency.

8.4 Emergency Lighting

The *Braun Building* is equipped with emergency lighting. Emergency lighting provides illumination to exits, corridors and principle exit routes in the event of the loss of primary power.

8.5 Fire Routes

Fire routes are areas of access for responding Fire Professionals. Obey the signs posted and park only in designated parking spots.

Chapter 9: Alternative Measures for Fire Safety

In the event of any shut down of fire protection equipment systems (either entirely or partially), alternate measures for fire safety must be taken. For any shut down of fire protection equipment in excess of 24 hours, the Fire Department shall be notified in writing.

Occupants will be notified of the areas affected by the shutdown and instructions for alternate fire safety measures or actions will be posted as to alternative provisions or actions to be taken in case of emergency. These provisions and actions must be acceptable to the Chief Fire Official.

9.1 Fire Alarm Systems

- It is the responsibility of Physical Plant to notify Security Services when any or all of a fire alarm system is out of service.
- Security will notify the Fire Department with a description of the problem and the anticipated length of time needed to correct it.
- Security will notify the monitoring company that a portion of the fire alarm system is offline.
- The Office of Human Resources – Health & Safety will notify the building supervisory staff that the fire alarm system is temporarily shut down.
- While the fire alarm is out of service, Security Services will either lock out the building or initiate a fire watch. During a Fire Watch a walkthrough of the affected area will be completed regularly by Security Services until such a time that the fire alarm service is restored.
- Notices will be posted on all exits and the main entrance by Security, stating the problem and when it is expected to be corrected.
- Security will notify the Fire Department, the monitoring company and the building occupants when the fire alarm system is back in operation.

9.2 Water System Shutdown

- It is the responsibility of Physical Plant to notify Security Services when all or part of the water system is out-of-service.

- Security Services will notify the Fire Department that all or part of the water system on campus is out-of-service, as well as the location of any fire hydrants taken out-of-service.
- Physical Plant will bag and lock out any fire hydrants that have been taken out of service.

9.3 Emergency Power Shutdown

- It is the responsibility of Physical Plant to notify Security Services when all or part of the emergency power system is out-of-service.
- Security Services will notify the Office of Media Relations to send out a general notice to the University Community and will notify the Fire Department that all or part of the emergency power system is out-of-service.

9.4 Fire Watch

A fire watch is implemented to ensure the fire safety of a building or area of a building and to minimize the impact of malfunctioning equipment. Security officers dedicated to a fire watch are responsible for patrolling the affected area(s) at least once every hour.

A fire watch is required when:

1. Failure of the fire alarm system occurs.
2. Failure of fire safety equipment occurs.
3. Any act which causes an increased risk to persons or property, such as hot works.
4. The Fire Department requests a fire watch be initiated.

9.5 Exits

Exits shall not be obstructed. In the event that planned construction or maintenance will cause an exit to become unusable, the following emergency procedures will be employed:

- Ensure the planned construction or maintenance is in compliance with municipal building permits.
- Ensure alternative measures are developed to compensate for the blocked exits.
- Post temporary exit signs to clearly identify the alternate exits.
- If necessary, create emergency evacuation procedures.

Physical Plant will alert the building occupants to obstructed exits via a communication bulletin.

9.6 Fire Extinguishers

It is the responsibility of Security Services to provide a temporary fire extinguisher (of equal type and rating) when a fire extinguisher has been removed for servicing.

Chapter 10: Fire Drills

Fire drills are regularly conducted to ensure that all building occupants are familiar with fire evacuation procedures. Fire drills assist Security Services and Human Resources staff in revising and refining fire emergency procedures.

The Braun Building will have scheduled fire drills twice a year and fire drill records are required to be retained for a period of one year. Every attempt will be made to schedule fire drills so that they do not conflict with tests. Drills will not occur during scheduled examination periods.

All occupants of a building must evacuate immediately during a fire drill

Building occupants should report any observations made during the evacuation to a Fire Warden. Fire Wardens should report any problems encountered during the evacuation drill to Health & Safety by calling 807-343-8010 Ext 8806.

Chapter 11: Maintenance Schedule as Required by the Ontario Fire Code

The following is a list of the portions of the Fire Code that require checks, inspections, and/or tests to be conducted of the facilities. Permanent records of all tests and corrective measures taken are required to be retained for a period of two years after they are made. If the time interval between tests exceeds two years, then the records shall be retained for the period of the test interval plus one year.

Records are to be made available upon the request of the Chief Fire Official or Fire Prevention Officers.

This list has been prepared for convenience only. For accurate reference, the fire code and referenced standards should be consulted.

Definitions of key terms include:

Check: means visual observation to ensure the device or system is in place and is not obviously damaged or obstructed.

Test: means the operation of a device or system to ensure that it will perform in accordance with its intended operation or function.

Inspect: means physical examination to determine that the device or system will apparently perform in accordance with its intended function.

11.1 Daily Tasks

Responsibility	Task	Description	Fire Code Reference
Security	Inspect	Fire alarm system for status of primary and remote trouble indicators and primary power "on" indicator.	6.3.2.2. CAN/ULC-S536

11.2 Monthly Tasks

Responsibility	Task	Description	Fire Code Reference
Maintenance	Inspect	Doors in fire separations.	2.2.3.4.
Contractor	Check	Pilot lights on emergency lighting unit equipment for operation.	2.7.3.3.(1)
Contractor	Inspect	Emergency lighting unit equipment.	2.7.3.3.(2)
Contractor	Test	Emergency lighting unit equipment for function upon failure of the primary power supply.	2.7.3.3.(3)(a)
Contractor	Inspect and Test	Batteries that provide emergency power for lights referred to in 2.7.3.3. (5)	2.7.3.3. (6)
Security	Inspect	Portable fire extinguishers and record electronically or on the attached tag.	6.2.7.2.
Security	Inspect	Hose stations to ensure that the hose is in the proper position and that all of the equipment is in place and operable.	6.4.2.1.
Contractor	Inspect and Test	Fire alarm system for operability: initiating device, alert/alarm/trouble signals, annunciator, battery, voice paging and emergency telephones.	6.3.2.2. CAN/ULC-S536

11.3 Semi-annual Tasks

Responsibility	Task	Description	Fire Code Reference
Security and Health & Safety	Conduct	Fire drills of all buildings that house laboratories or studios.	4.12.4.1.(2)

Maintenance	Inspect and clean	Ventilation systems of a power ventilated enclosure serving a laboratory or studio.	4.12.7.1.(2)(b)
Contractor	Inspect, Test and Maintain	Special extinguishing systems and components.	6.8.1.1.(1) NFPA 11-17A

11.4 Annual Tasks

Responsibility	Task	Description	Fire Code Reference
Maintenance	Operate	Disconnect switch for mechanical air-condition and ventilation systems.	2.6.1.8.
Contractor	Test	Emergency lighting unit equipment for design duration.	2.7.3.3.(3)(b)
Contractor	Test and Inspect	Emergency lighting equipment charging conditions for voltage, current and recovery period to ensure manufacturer's specifications are met.	2.7.3.3.(4)
Health & Safety	Review	Fire safety plan as often as necessary but at intervals not greater than 12 months.	2.8.2.1.(4)
Contractor	Inspect and maintain	Electrical equipment, mechanical systems, piping, valves, and automatic and manual control and safety devices	4.12.7.1.(1)
Contractor	Inspect and clean	Ventilation systems serving a laboratory for the ventilation systems of the open laboratory areas.	4.12.7.1.(1)(a)
Contractor	Maintain	Fire extinguishers (mechanical parts, extinguishing agent, and expelling means will be thoroughly examined)	6.2.7.1. NFPA 10
Contractor	Inspect and Test	Fire alarm system operability and all components and devices	6.3.2.2. CAN/ULC-S536
Maintenance	Inspect	Private hydrants annually and after each use.	6.6.5.1. - 6.6.5.5.
Maintenance	Inspect/check	Private hydrants water flow.	6.6.5.6.
Contractor	Inspect	Fire department standpipe and hose system connections (plugs or caps removed) for wear, rust or obstruction.	6.4.1.3.(2)

Fire Safety Plan: Braun Building

2025

Contractor	Inspect	Hose valves to ensure that they are tight so that there is no water leakage into the hose.	6.4.2.4.
Contractor	Inspect / Re-rack	Standpipe hose and replace worn hose or gaskets.	6.4.2.5.(1)
Contractor	Inspect, Test and Maintain	Special extinguishing systems and components.	6.8.1.1.(1) NFPA 11-17A

11.5 Tasks Every Five (5) Years

Responsibility	Task	Description	Fire Code Reference
Contractor	Test	H2O, CO2 and dry chemical (stainless steel shell) extinguishers, hydrostatically tested.	6.2.7.1. NFPA 10
Contractor	Inspect, Test and Maintain	Special extinguishing systems and components.	6.8.1.1.(1) NFPA 11-17A

11.6 Tasks Every Six (6) Years

Responsibility	Task	Description	Fire Code Reference
Contractor	Maintain	Stored-pressure fire extinguishers that require a 12-year hydrostatic test by emptying and subjecting to the applicable maintenance procedures.	6.2.7.1. NFPA 10

11.7 Tasks Every Twelve (12) Years

Responsibility	Task	Description	Fire Code Reference
Contractor	Test	Extinguishers with milled steel shells hydrostatically tested.	6.2.7.1. NFPA 10

11.8 Tasks, As Required

Responsibility	Task	Description	Fire Code Reference

Fire Safety Plan: Braun Building

2025

Security	Check	Doors in fire separations in occupied buildings as frequently as necessary to ensure that they remain closed.	2.2.3.5.(1)
Maintenance	Inspect	Fire dampers, as required.	2.2.3.7.
Security	Maintain	Access for firefighting free of obstructions.	2.5.1.2.(1)
Security	Maintain	Fire access routes to be immediately ready for fire department vehicles.	2.5.1.3.
Health & Safety	Review	Fire safety plan as often as necessary but at intervals not greater than 12 months.	2.8.2.1.(4)
Contractor	Test	Standpipe systems that have been modified extended or are being restored to service after a period of disuse exceeding one (1) year, hydrostatically and for flow and pressure.	6.4.3.1.(1)
Maintenance	Maintain	Fire department sprinkler and standpipe connections free of obstructions.	2.5.1.2.(3)
Contractor	Inspect	After any alterations or repairs, an inspection shall be made to ensure valves are returned to the fully open position and are sealed, locked or electrically supervised.	6.6.1.2.(3)
Security	Maintain	When an emergency power system or any part thereof is shut down, the supervisory stall shall be notified.	6.7.1.1.(3)
Security	Maintain	Required exit signs in a clean and legible condition and clearly visible.	2.7.3.1.
Security	Illuminate	Exit signs while the building is occupied.	2.7.3.2.
Contractor	Inspect, Test and Maintain	Special extinguishing systems and components.	6.8.1.1.(1) NFPA 11-17A

Fire Drill Report

Building:

Date:

Time:

In attendance:

Comments and/or Deficiencies Noted:

Signature: _____

SDS - FM 200

**SAFETY DATA SHEET**
FM-200®
(Fire Extinguishing Agent with Expellant)

1. IDENTIFICATION

Product Name	FM-200® (Fire Extinguishing Agent with Expellant)
Other Names	Heptafluoropropane, HFC-227ea
Recommended use of the chemical and restrictions on use	
Identified uses	Fire Extinguishing Agent
Restrictions on use	Consult applicable fire protection codes
Company Identification	Kidde-Fenwal, Inc. 400 Main Street Ashland, MA 01721 USA
Customer Information Number	(508) 881-2000
Emergency Telephone Number	
Chemtrec Number	(800) 424-9300 (703) 527-3887 (International)
Issue Date	October 1, 2015
Supersedes Date	April 10, 2015

Safety Data Sheet prepared in accordance with OSHA's Hazard Communication Standard (29 CFR 1910.1200) and the Globally Harmonized System of Classification and Labelling of Chemicals (GHS)

2. HAZARD IDENTIFICATION

Hazard Classification

Gas under pressure – liquefied gas
Simple Asphyxiant

Label Elements**Hazard Symbols**

Signal Word: Warning

Hazard Statements

Contents under pressure; may explode if heated.
May displace oxygen and cause rapid suffocation.

Precautionary Statements**Prevention**

Do not enter confined space unless adequately ventilated.
In case of inadequate ventilation wear respiratory protection.



SAFETY DATA SHEET
FM-200®
(Fire Extinguishing Agent with Expellant)

2. HAZARD IDENTIFICATION

Response

None

Storage

Keep container tightly closed.

Protect from sunlight and store in well-ventilated place.

Disposal

None

Other Hazards

Direct contact with the cold gas or liquid can cause freezing of exposed tissues. Exposure to vapor at high concentrations can cause cardiac sensitization and suffocation if air is displaced by vapors.

Specific Concentration Limits

The values listed below represent the percentages of ingredients of unknown toxicity.

Acute oral toxicity 0%

Acute dermal toxicity 0%

Acute inhalation toxicity 0%

Acute aquatic toxicity 0%

3. COMPOSITION/INFORMATION ON INGREDIENTS

Synonyms: Heptafluoropropane
This product is a substance.

Component	CAS Number	Concentration
1,1,1,2,3,3,3-Heptafluoropropane	431-89-0	>99.9%

Note: The expellant is nitrogen.

4. FIRST- AID MEASURES

Description of necessary first-aid measures**Eyes**

Immediately flood the eye with plenty of water for at least 15 minutes, holding the eye open. Obtain medical attention if soreness or redness persists.

Skin

Flush with water. Obtain medical attention if frostbite or blistering occurs or redness persists.

Ingestion

Ingestion is not considered a potential route of exposure.

Inhalation

Remove from exposure. If there is difficulty in breathing, give oxygen. Obtain medical attention immediately.

Most important symptoms/effects, acute and delayed

Aside from the information found under Description of necessary first aid measures (above) and Indication of immediate medical attention and special treatment needed, no additional symptoms and effects are anticipated.



SAFETY DATA SHEET
FM-200®
(Fire Extinguishing Agent with Expellant)

4. FIRST- AID MEASURES

Indication of immediate medical attention and special treatment needed**Notes to Physicians**

In case of frostbite, place the frostbitten part in warm water. If warm water is not available or impractical to use, wrap the affected parts gently in blankets. DO NOT USE HOT WATER.

The use of epinephrine or similar compounds can increase susceptibility to heart irregularities caused by excessive exposure to these types of compounds.

5. FIRE - FIGHTING MEASURES

Suitable Extinguishing Media

FM-200® is used as an extinguishing agent and therefore is not a problem when trying to control a blaze. Use extinguishing agent appropriate to other materials involved. Keep containers and surroundings cool with water spray as containers may rupture or burst in the heat of a fire.

Specific hazards arising from the chemical

Containers may explode in heat of fire.

Special Protective Actions for Fire-Fighters

Wear full protective clothing and self-contained breathing apparatus as appropriate for specific fire conditions.

6. ACCIDENTAL RELEASE MEASURES

Personal precautions, protective equipment and emergency procedures

Wear full protective clothing and self-contained breathing apparatus. Remove leaking cylinder to a safe place. Ventilate the area. Leaks inside confined spaces may cause suffocation as vapors may displace air, and should not be entered without a self-contained breathing apparatus.

Environmental Precautions

Prevent the material from being released into the environment.

Methods and materials for containment and cleaning up

Material evaporates.

7. HANDLING AND STORAGE

Precautions for safe handling

Wear appropriate protective clothing. Prevent skin and eye contact.

Conditions for safe storage

Pressurized containers should be properly stored and secured to prevent falling or being knocked over. Do not drag, slide or pressurized containers. Do not drop pressurized containers or permit them to strike against each other. Never apply flame or localized heat directly to any part of the pressurized or plastic container. Store pressurized and plastic containers away from high heat sources. Storage area should be: - cool - dry - well ventilated - under cover - out of direct sunlight



SAFETY DATA SHEET
FM-200®
(Fire Extinguishing Agent with Expellant)

8. EXPOSURE CONTROLS/PERSONAL PROTECTION

Control parameters

Exposure limits are listed below, if they exist.

1,1,1,2,3,3-Heptafluoropropane

None assigned.

Appropriate engineering controls

Use with adequate ventilation. There should be local procedures for the selection, training, inspection and maintenance of this equipment. When used in large volumes or odor becomes apparent, use local exhaust ventilation.

Individual protection measures

Respiratory Protection

Not normally required under conditions of use as a portable fire extinguisher. For other applications creating oxygen deficient atmospheres, use a self contained breathing apparatus, as an air purifying respirator will not provide protection.

Skin Protection

Wear rubber gloves. Avoid contact with skin.

Eye/Face Protection

Chemical goggles or safety glasses with side shields. Avoid contact with eyes.

Body Protection

Normal work wear.

9. PHYSICAL AND CHEMICAL PROPERTIES

Agent – FM-200®

Appearance

Physical State	Liquefied gas under pressure
Color	Colorless
Odor	Slight ether like
Odor Threshold	No data available
pH	Neutral
Specific Gravity	1.46
Boiling Range/Point (°C/F)	-16.4°C/3°F
Melting Point (°C/F)	-129.5°C/265°F
Flash Point (PMCC) (°C/F)	Not flammable
Vapor Pressure	540 hPa at -30 °C 29,360 hPa at 123 °C
Evaporation Rate (BuAc=1)	Not applicable
Solubility in Water	0.23 g/l at 25°C
Vapor Density (Air = 1)	5.8
VOC (%)	Not applicable
Partition coefficient (n-octanol/water)	2289
Viscosity	Not applicable
Auto-ignition Temperature	No data available
Decomposition Temperature	No data available



SAFETY DATA SHEET
FM-200®
(Fire Extinguishing Agent with Expellant)

9. PHYSICAL AND CHEMICAL PROPERTIES

Upper explosive limit	Not explosive
Lower explosive limit	Not explosive
Flammability (solid, gas)	Not flammable
Expellant - Nitrogen	
Appearance	Compressed gas
Physical State	Colorless
Color	None
Odor	No data available
Odor Threshold	Not applicable
pH	0.075 lb/ft ³ @70°F as vapor
Specific Gravity	-196°C/-321°F
Boiling Range/Point (°C/F)	No data available
Melting Point (°C/F)	Not flammable
Flash Point (PMCC) (°C/F)	838 psig @70°F and 1 atmosphere(Carbon Dioxide)
Vapor Pressure	No data available
Evaporation Rate (BuAc=1)	No data available
Solubility in Water	No data available
Vapor Density (Air = 1)	Not applicable
VOC (g/l)	None
VOC (%)	None
Partition coefficient (n-octanol/water)	No data available
Viscosity	Not applicable
Auto-ignition Temperature	No data available
Decomposition Temperature	No data available
Upper explosive limit	Not explosive
Lower explosive limit	Not explosive
Flammability (solid, gas)	Not flammable

10. STABILITY AND REACTIVITY

Reactivity

Decomposes on heating. Containers may rupture or explode if exposed to heat.

Chemical Stability

Stable under normal conditions.

Possibility of hazardous reactions

Hazardous polymerization will not occur.

Conditions to Avoid

Heat - High temperatures - Exposure to direct sunlight

Incompatible Materials

Powdered metals (ex. aluminum, zinc, etc.) - strong oxidizing agents - strong reducing agents - strong alkalis

Hazardous Decomposition Products

Oxides of carbon - hydrogen halides - fluorocarbons - carbonyl halides



SAFETY DATA SHEET
FM-200®
(Fire Extinguishing Agent with Expellant)

11. TOXICOLOGICAL INFORMATION

Acute Toxicity

FM-200®

4 hour LC50(rat) >788,698 ppm

Low Observed Adverse Effect Concentration (LOAEC)/dog : 105000 ppm

Cardiac sensitization

No Observed Adverse Effect Concentration (NOAEC)/dog : 90000 ppm

Nitrogen

Simple asphyxiant

Specific Target Organ Toxicity (STOT) – single exposure

Nitrogen: Exposure to nitrogen gas at high concentrations can cause suffocation by reducing oxygen available for breathing. Breathing very high concentrations can cause dizziness

Specific Target Organ Toxicity (STOT) – repeat exposure

No relevant studies identified.

Serious Eye damage/Irritation

Not expected to cause eye irritation based on review of properties of the substance.

Skin Corrosion/Irritation

Not expected to cause skin irritation based on review of properties of the substance.

Respiratory or Skin Sensitization

FM-200®: Not expected to cause skin sensitization based on review of properties of the substance. Did not cause respiratory sensitization in laboratory animals.

Carcinogenicity

Not considered carcinogenic by NTP, IARC, and OSHA.

Germ Cell Mutagenicity

FM-200®: Animal testing and testing on bacterial or mammalian cell cultures did not show mutagenic effects.

Reproductive Toxicity

FM-200®: Animal testing showed no reproductive toxicity. (Based on data obtained from similar substances.) Animal testing showed no developmental toxicity.

Aspiration Hazard

Not an aspiration hazard.

Other

FM-200®: Cardiac sensitization threshold limit : 730190 mg/m3

12. ECOLOGICAL INFORMATION

Ecotoxicity

FM-200®

LC50 > 200 mg/l zebra fish 96h

EC50> 200 mg/l Water flea 48h



SAFETY DATA SHEET
FM-200®
(Fire Extinguishing Agent with Expellant)

12. ECOLOGICAL INFORMATION

Mobility in soil

No relevant studies identified.

Persistence/Degradability

Not readily biodegradable.

Bioaccumulative Potential

No relevant studies identified.

Other adverse effects

No relevant studies identified.

13. DISPOSAL CONSIDERATIONS

Disposal Methods

Dispose of container in accordance with all applicable local and national regulations. Do not cut puncture or weld on or near to the container. If spilled, contents will vaporize to the atmosphere.

14. TRANSPORT INFORMATION

Safety Data Sheet information is intended to address a specific material and not various forms or states of containment.

DOT CFR 172.101 Data

Heptafluoropropane, 2.2, UN3296

UN Proper Shipping Name

Heptafluoropropane

UN Class

(2.2) Non-Flammable Gas

UN Number

UN3296

UN Packaging Group

Not applicable

Classification for ADR

Consult current IATA Regulations prior to shipping by air.

Transportation (IATA)

Consult current IMDG Regulations prior to shipping by water.

Classification for Water

Consult current IMDG Regulations prior to shipping by water.

Transport IMDG

This section is believed to be accurate at the time of preparation. It is not intended to be a complete statement or summary of the applicable laws, rules, or hazardous material regulations, and is subject to change. Users have the responsibility to confirm compliance with all laws, rules, and hazardous material regulations in effect at the time of shipping.

15. REGULATORY INFORMATION

United States TSCA Inventory

All components of this product are in compliance with the inventory listing requirements of the US Toxic Substance Control Act (TSCA) Chemical Substance Inventory.

Canada DSL Inventory

All ingredients in this product have been verified for inclusion on the Domestic Substance List (DSL).

SARA Title III Sect. 311/312 Categorization

Pressure Hazard



SAFETY DATA SHEET
FM-200®
(Fire Extinguishing Agent with Expellant)

15. REGULATORY INFORMATION

SARA Title III Sect. 313

This product does not contain any chemicals listed in Section 313 at or above de minimis concentrations.

16. OTHER INFORMATION

NFPA Ratings

NFPA Code for Health - 1
NFPA Code for Flammability - 0
NFPA Code for Reactivity - 0
NFPA Code for Special Hazards – None

HMIS Ratings

HMIS Code for Health - 1
HMIS Code for Flammability - 0
HMIS Code for Physical Hazard - 0
HMIS Code for Personal Protection - See Section 8

*Chronic

Legend

ACGIH: American Conference of Governmental Industrial Hygienists
CAS: Chemical Abstracts Service
IARC: International Agency for Research on Cancer
N/A: Denotes no applicable information found or available
NTP: National Toxicology Program
OSHA: Occupational Safety and Health Administration
PEL: Permissible Exposure Limit
SDS: Safety Data Sheet
STEL: Short Term Exposure Limit
TLV: Threshold Limit Value

Information Source and References

This SDS is prepared by Hazard Communication Specialists based on information provided by internal company references.

Revision Date:

Replaces: April 10, 2015

Changes made: Update to Section 14.

Prepared By: EnviroNet LLC.

FM-200 is a registered trademark of DuPont.

The information and recommendations presented in this SDS are based on sources believed to be accurate. Kidde-Fenwal, Inc. assumes no liability for the accuracy or completeness of this information. It is the user's responsibility to determine the suitability of the material for their particular purposes. In particular, we make **NO WARRANTY OF MERCHANTABILITY OR ANY OTHER WARRANTY, EXPRESS OR IMPLIED**, with respect to such information, and we assume no liability resulting from its use. Users should ensure that any use or disposal of the material is in accordance with applicable Federal, State, and local laws and regulations.
